


No Surcharge Allowed

No Surcharge Allowed

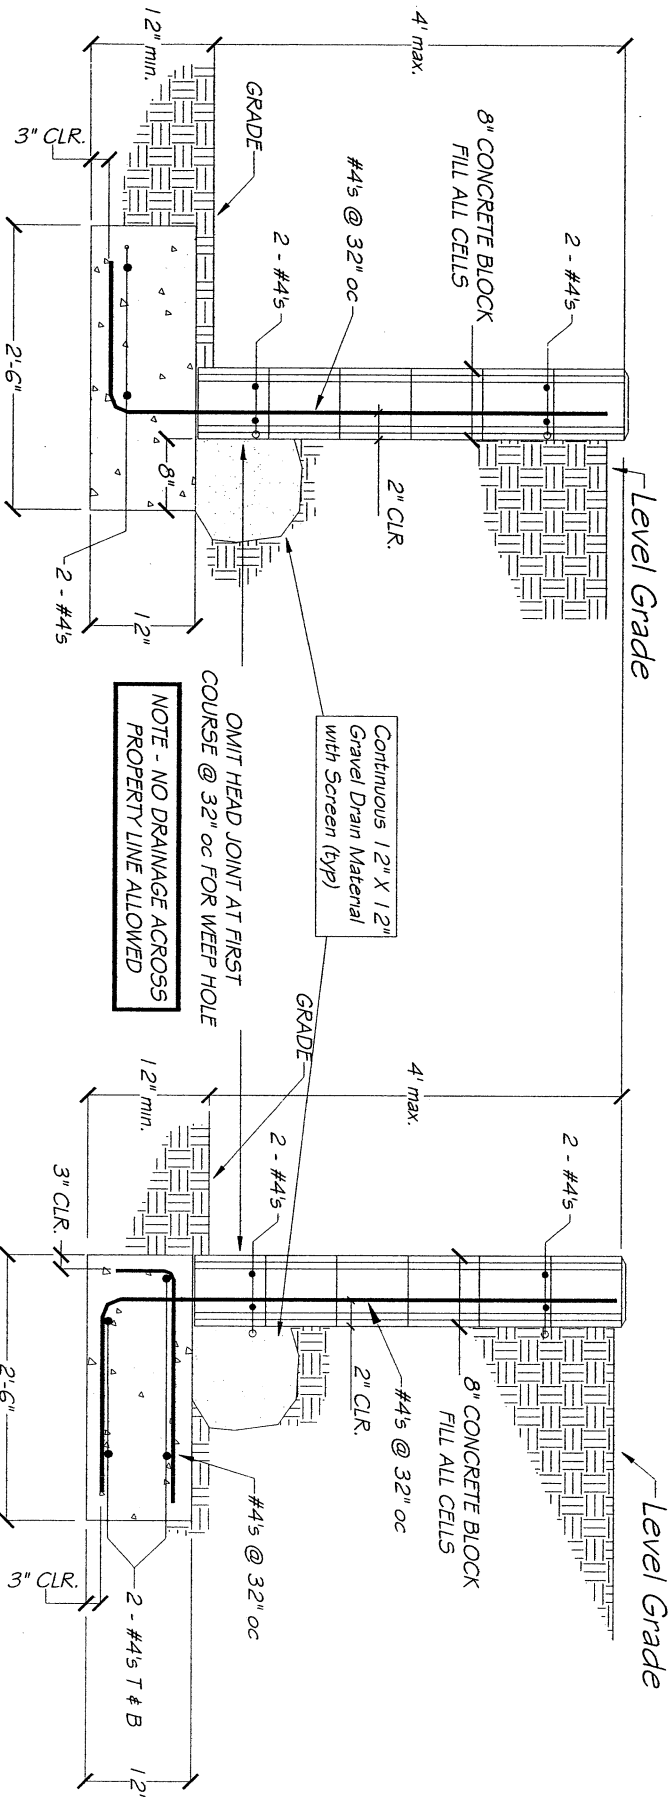

Note- Engineering Calculation & Details Required For All Retaining Walls Other Than Shown On This Sheet.

DESIGN FOR LEVEL GRADE ONLY AT TOP OF WALL (1998 CBC)

Concrete strength 2,500 PSI minimum age tested at 28 days.

Concrete block - grade "N" units A.5, T.M. C-90.

Grout - 1 part cement, 3 parts sand, 2 parts pea gravel.

Mortar - 1 part cement, 1/2 part lime putty (type "S"), 4-1/2 parts sand.

Revised 8/10/00

RETAINING WALLS

CITY OF HUNTINGTON BEACH

APPROVED: REDACTED

BUILDING & SAFETY DIRECTOR

DATE: 5/20/04

STANDARD
PLAN NO.
3

